


448-446  
A-004  
Control  
7-1-1  
7-1-1

DRAWING NUMBER  
7-1-1  
7-1-1


DRAWING NUMBER  
7-1-1  
7-1-1

DRAWING NUMBER  
7-1-1  
7-1-1


WEST STREET

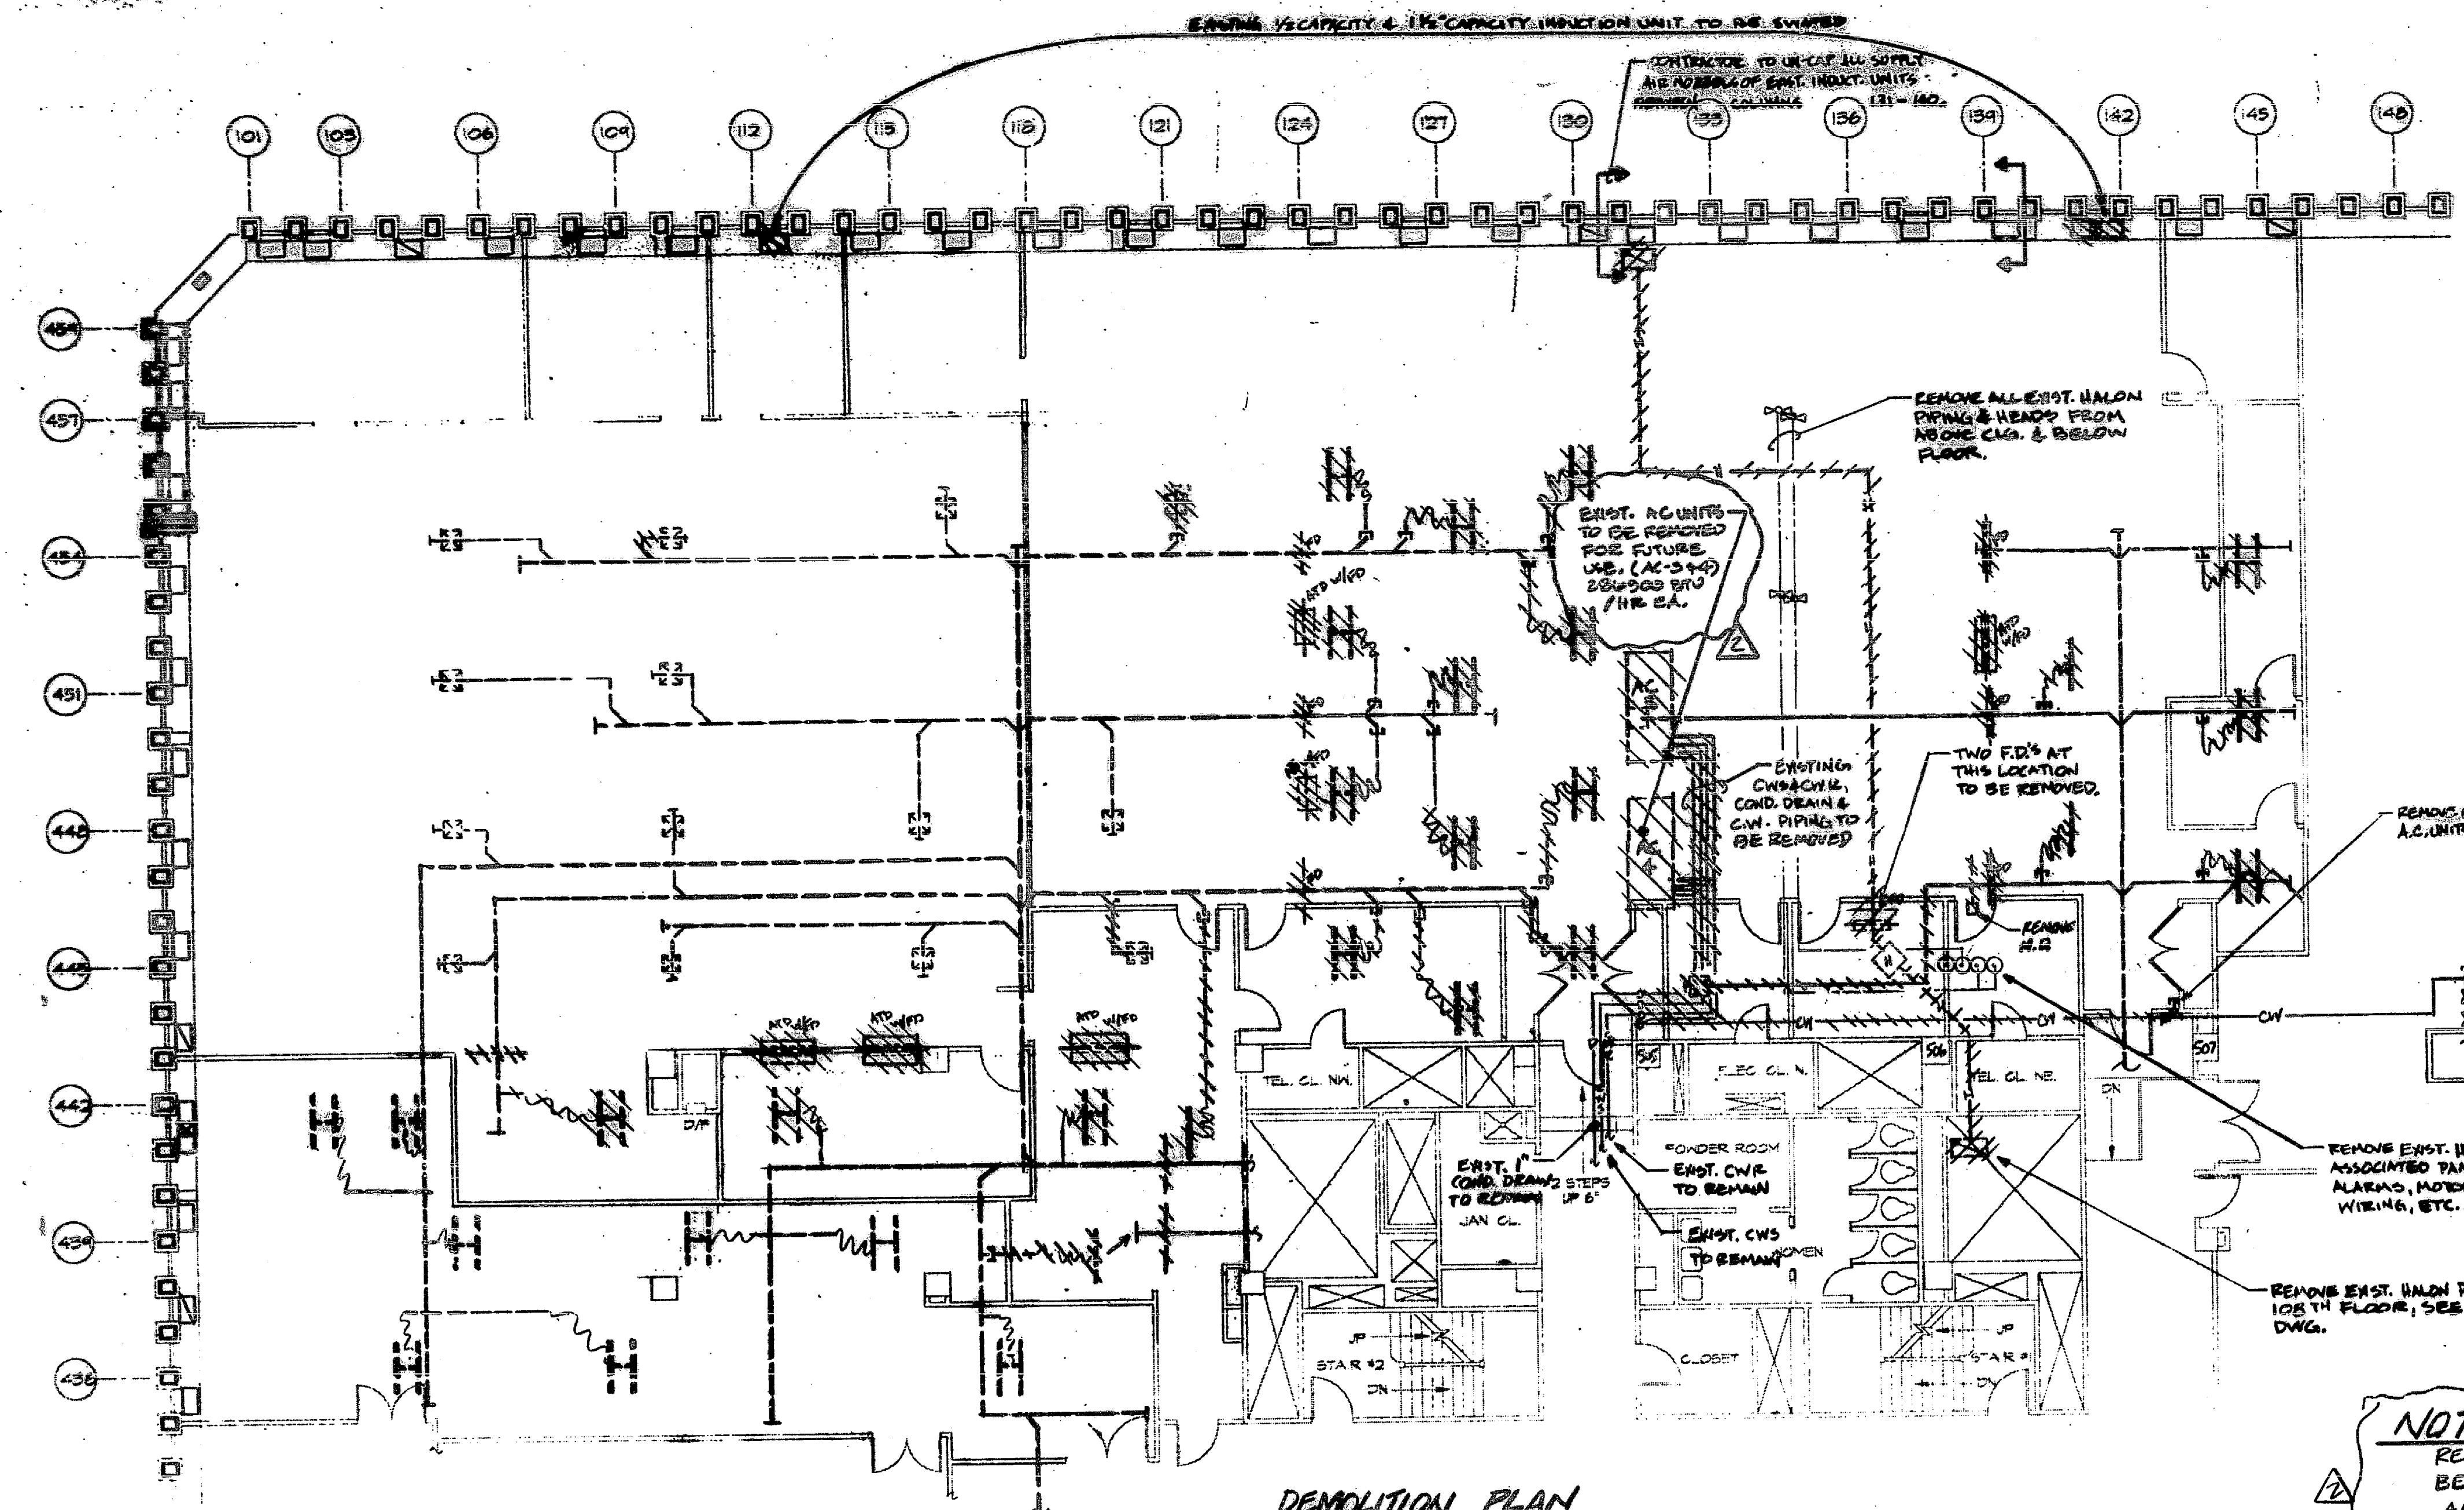

DEMOLITION PLAN  
1/8" = 1'-0"

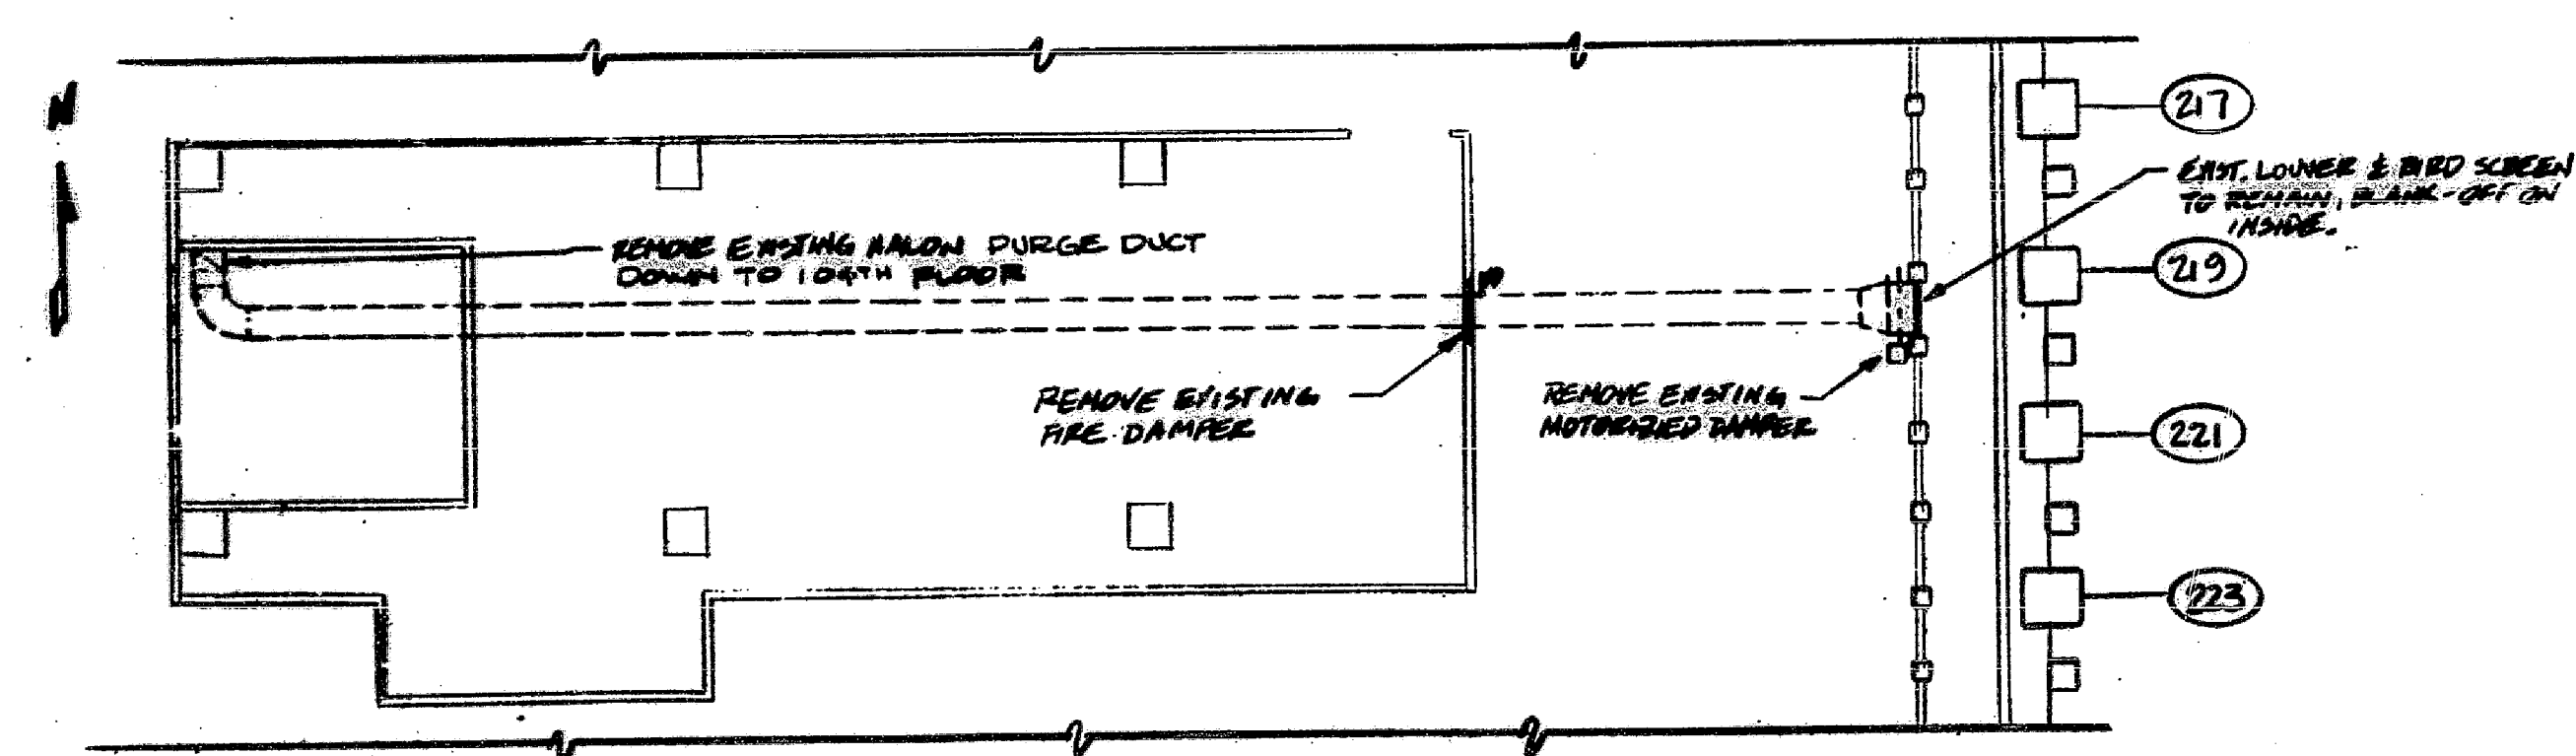

PART PLAN 108TH FLOOR  
1/8" = 1'-0"

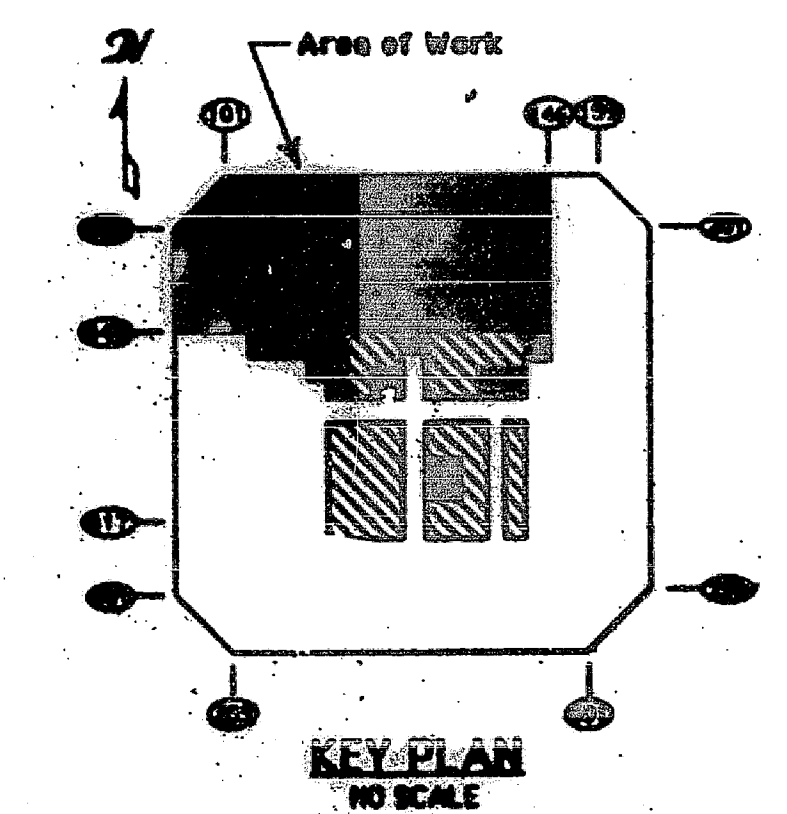

KEY PLAN  
NO SCALE

LEGEND

- EXISTING BASEBUILDING DUCTWORK TO REMAIN
- EXISTING BASEBUILDING DUCTWORK TO BE REMOVED
- EXISTING HALON PURGE DUCTWORK TO BE REMOVED
- EXISTING SUPPLY AIR DIFFUSER TO REMAIN
- EXISTING SUPPLY AIR DIFFUSER TO BE REMOVED OR RELOCATED
- EXISTING DOUBLE POUCH TO REMAIN
- EXISTING DOUBLE POUCH TO BE REMOVED
- EXISTING SINGLE POUCH TO BE REMOVED
- EXISTING AIR TRANSFER DUCT AND FIRE DAMPER TO BE REMOVED OR RELOCATED
- EXISTING FIRE DAMPER TO BE REMOVED
- EXISTING HALON PURGE FAN TO BE REMOVED
- EXISTING 1/2 CAP. INDUCTION UNIT TO BE RELOCATED
- EXISTING 1/2 CAP. INDUCTION UNIT TO BE RELOCATED
- EXISTING FULL CAP. INDUCTION UNIT TO BE REMAIN
- EXISTING 1/2 CAP. INDUCTION UNIT TO BE REMAIN
- EXISTING 1/2 CAP. INDUCTION UNIT TO BE REMAIN
- MOTORIZED DAMPER TO BE REMOVED
- HALON PIPING TO BE REMOVED
- HALON TANKS TO BE REMOVED
- COLD WATER PIPING TO BE REMOVED
- COLD WATER PIPING TO REMAIN

NOTE:  
REMOVAL OF EXISTING HALON TANKS SHALL BE PERFORMED IN A MANNER SUCH THAT ALL PRECAUTIONS ARE TAKEN TO PREVENT A DISCHARGE. CONTAINERS SHALL BE RETURNED TO THE PROPER AUTHORITIES FOR RECYCLING AS PER N.F.P.A. 12A SECTION 1-9.4.2



2	REVISION AS PER P.A. COMMENTS	7-5-92
1	AS PER P.A. COMMENTS	7-1-92
REV. No.		
Center Fitzgerald Securities One World Trade Center, Floor 104 New York, NY 10048		
MECHANICAL DESIGN/ENGINEERING FIRM		
John C. Wehrick & Associates, Inc. CONSULTING ENGINEERS 3110 Maple Avenue Southfield, MI 48034 (313) 281-4000 Fax (313) 281-4004		
SCALE AS NOTED	DATE 7-1-92	BY J.C.W.
DESIGNED BY J.C.W.	CHECKED BY J.C.W.	IN CHARGE BY J.C.W.